

**PROJECT MANUAL
FOR
CITY OF LYNCHBURG**

May 21, 2013

**Roof Replacement for
Task 7: STORAGE BUILDING AT
FORMER ALLEN MORRISON SITE**

300 Rutherford Street Lynchburg, VA

Lynchburg City Building Number: PR82



**PROCUREMENT DIVISION
3RD FLOOR CITY HALL
900 CHURCH STREET
LYNCHBURG, VA 24504
TELEPHONE (434) 455-3961
FAX (434) 845-0711**

SECTION 00-0110

TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS

Division 00 -- Procurement and Contracting Requirements

00-0110 - Table of Contents

SPECIFICATIONS

Division 01 -- General Requirements

01-1000 - Summary

01-3000 - Administrative Requirements

01-4000 - Quality Requirements

01-5000 - Temporary Facilities and Controls

01-6000 - Product Requirements

01-7000 - Execution and Closeout Requirements

Division 02 -- Existing Conditions

02-4100 - Demolition

Division 04 -- Masonry

04-0100 - Maintenance of Masonry

Division 05 -- Metals

05-3100 - Steel Decking

Division 06 -- Wood, Plastics, and Composites

06-1000 - Rough Carpentry

Division 07 -- Thermal and Moisture Protection

07-0150.19 - Preparation for Re-Roofing

07-5300 - Elastomeric Membrane Roofing

07-6200 - Sheet Metal Flashing and Trim

END OF TABLE OF CONTENTS

SECTION 01-1000

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: Roof Replacement for Task 7: Storage Building at former Allen Morrison Site.
- B. Owner's Name: City of Lynchburg.
 - 1. Owner's Project Representative: Randy Dalton.
- C. Architect's Name: Craddock Cunningham Architectural Partners.
 - 1. Project Architect: Mark W. Smith
- D. The Project consists of a storage building with brick load-bearing walls and parapet with an asphalt built-up roof and terra cotta coping.
 - 1. Remove the built-up asphalt roof membrane, deck insulation, metal roof deck and flashings. Replace with new metal deck, insulation and adhered EPDM system with associated flashings. Replace missing and broken terra cotta coping. Clean the interior structural steel and masonry walls. Remove HVAC unit, lights and ceiling mounted conduit. Paint entire ceiling, steel columns and sprinkler lines.
 - 2. Building area is approximately 3,600 square feet.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price as described in agreement.

1.03 OWNER OCCUPANCY

- A. Owner will not occupy the building during construction.

1.04 CONTRACTOR USE OF SITE AND PREMISES

- A. Construction Operations: Limited to surrounding areas. The site has adequate open space for roofing operations.
- B. Parking and Storage: The contractor may use parking areas and the interior of the storage building for storage.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01-3000

ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preconstruction meeting.
- B. Submittals for review, information, and project closeout.
- C. Submittal procedures.

1.02 RELATED REQUIREMENTS

- A. Section 01-7000 - Execution and Closeout Requirements: Additional coordination requirements.

1.03 PROJECT COORDINATION

- A. Project Coordinator: Randy Dalton.
- B. During construction, coordinate use of site and facilities through the Project Coordinator.
- C. Comply with instructions of the Project Coordinator for use of temporary utilities and construction facilities.
- D. The project coordinator may allow the general contractor to submit the following directly to the architect. This will be determined at the pre-construction meeting:
 - 1. Requests for interpretation.
 - 2. Requests for substitution.
 - 3. Shop drawings, product data, and samples.
 - 4. Test and inspection reports.
 - 5. Manufacturer's instructions and field reports.
 - 6. Applications for payment and change order requests.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRECONSTRUCTION MEETING

- A. Owner will schedule a meeting after Notice of Award.
- B. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
- C. Agenda:
 - 1. Designation of personnel representing the parties to Contract, Contractor and Architect.
 - 2. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 3. Use of premises by Owner and Contractor.
 - 4. Scheduling.
 - 5. Procedures for maintaining record documents.
 - 6. Security and housekeeping procedures.
 - 7. Temporary utilities provided by Owner.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.02 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 - 1. Product data.

COL Task 7
Storage Building at Former A-M Site

2. Shop drawings.
 3. Samples for selection.
 4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.
- C. Samples will be reviewed only for aesthetic, color, or finish selection.

3.03 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout:
1. Project record documents.
 2. Operation and maintenance data.
 3. Warranties.
 4. Bonds.
 5. Other types as indicated.
- B. Submit for Owner's benefit during and after project completion.

3.04 SUBMITTAL PROCEDURES

- A. Transmit each submittal with architect provided form.
- B. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents.
- C. Deliver submittals to Architect at business address.
- D. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
- E. Identify variations from Contract Documents and Product or system limitations that may be detrimental to successful performance of the completed Work.
- F. Provide space for Contractor and Architect review stamps.
- G. When revised for resubmission, identify all changes made since previous submission.
- H. Distribute reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- I. Submittals not requested will not be recognized or processed.

END OF SECTION

SECTION 01-4000

QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Control of installation.
- B. Manufacturers' field services.

1.02 RELATED REQUIREMENTS

- A. Section 01-3000 - Administrative Requirements: Submittal procedures.

1.03 SUBMITTALS

- A. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.
- B. Manufacturer's Field Reports: Submit reports for Architect's benefit as contract administrator or for Owner.
 - 1. Submit for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.02 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

3.03 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not conforming to specified requirements.

COL Task 7
Storage Building at Former A-M Site

- B. If, in the opinion of Architect, it is not practical to remove and replace the Work, Architect will direct an appropriate remedy or adjust payment.

END OF SECTION

SECTION 01-5000

TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary sanitary facilities.
- C. Temporary Controls: Barriers and enclosures.
- D. Security requirements.
- E. Vehicular access and parking.
- F. Waste removal facilities and services.

1.02 TEMPORARY UTILITIES

- A. Owner will provide the following:
 - 1. Water supply, consisting of connection to existing facilities.
- B. Provide and pay for all electrical power required for construction purposes.
 - 1. Building does not have electric power. Provide generator or other means of temporary power.
- C. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.03 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. Maintain daily in clean and sanitary condition.

1.04 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas, to prevent access to areas that could be hazardous to workers or the public and to protect existing facilities and adjacent properties from damage from construction operations.
- B. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.05 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security program.

1.06 VEHICULAR ACCESS AND PARKING

- A. Provide and maintain access to fire hydrants, free of obstructions.
- B. Contractor may use entire parking area for construction use.

1.07 WASTE REMOVAL

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01-6000

PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Transportation, handling, storage and protection.
- B. Product option requirements.
- C. Substitution limitations and procedures.

1.02 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by the Contract Documents.
- B. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the Owner, or otherwise indicated as to remain the property of the Owner, become the property of the Contractor; remove from site.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.
- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

PART 3 EXECUTION

3.01 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- B. Architect will consider requests for substitutions only within 15 days after date established in Notice to Proceed.
- C. Substitutions may be considered when a product becomes unavailable through no fault of the Contractor.

COL Task 7
Storage Building at Former A-M Site

- D. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.
- E. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. Will coordinate installation and make changes to other Work that may be required for the Work to be complete with no additional cost to Owner.
 - 4. Waives claims for additional costs or time extension that may subsequently become apparent.
- F. Substitution Submittal Procedure:
 - 1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
 - 2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
 - 3. The Architect will notify Contractor in writing of decision to accept or reject request.

3.02 TRANSPORTATION AND HANDLING

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.
- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Provide bonded off-site storage and protection when site does not permit on-site storage or protection.
- G. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- H. Prevent contact with material that may cause corrosion, discoloration, or staining.
- I. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- J. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

COL Task 7
Storage Building at Former A-M Site

END OF SECTION

SECTION 01-7000

EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition, except removal, disposal, and/or remediation of hazardous materials and toxic substances.
- C. Pre-installation meetings.
- D. Cutting and patching.
- E. Cleaning and protection.
- F. Closeout procedures, except payment procedures.

1.02 RELATED REQUIREMENTS

- A. Section 01-1000 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01-5000 - Temporary Facilities and Controls: Temporary exterior enclosures.

1.03 REFERENCE STANDARDS

- A. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2009.

1.04 SUBMITTALS

- A. See Section 01-3000 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.

1.05 PROJECT CONDITIONS

- A. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
- B. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations. Comply with federal, state, and local regulations.

1.06 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements.
- B. Coordinate completion and clean-up of work of separate sections.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.

- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01-6000.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 PREINSTALLATION MEETINGS

- A. When required in individual specification sections, convene a preinstallation meeting at the site prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify Architect four days in advance of meeting date.
- D. Prepare agenda and preside at meeting:
 - 1. Review conditions of examination, preparation and installation procedures.
 - 2. Review coordination with related work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.04 GENERAL INSTALLATION REQUIREMENTS

- A. In addition to compliance with regulatory requirements, conduct construction operations in compliance with NFPA 241, including applicable recommendations in Appendix A.
- B. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- C. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- D. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- E. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- F. Make neat transitions between different surfaces, maintaining texture and appearance.

3.05 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
- B. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove items indicated on drawings.
 - 2. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 3. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- C. Protect existing work to remain.
 - 1. Prevent movement of structure; provide shoring and bracing if necessary.
 - 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 - 3. Repair adjacent construction and finishes damaged during removal work.
- D. Adapt existing work to fit new work: Make as neat and smooth transition as possible.

3.06 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 - 1. Complete the work.
 - 2. Fit products together to integrate with other work.
 - 3. Match work that has been cut to adjacent work.
 - 4. Repair areas adjacent to cuts to required condition.
 - 5. Repair new work damaged by subsequent work.
 - 6. Remove and replace defective and non-conforming work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to specified condition.
- E. Restore work with new products in accordance with requirements of Contract Documents.

3.07 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Extent of clean is limited to contractors scope of work.

3.08 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.

3.09 FINAL CLEANING

- A. Execute final cleaning prior to final project assessment.
- B. Extent of clean is limited to contractors scope of work.
- C. Clean debris from roofs, gutters, downspouts, and drainage systems.
- D. Clean site; sweep paved areas, rake clean landscaped surfaces.

COL Task 7
Storage Building at Former A-M Site

- E. Extent of clean is limited to contractors scope of work.

3.10 CLOSEOUT PROCEDURES

- A. Notify Architect when work is considered ready for Substantial Completion.
- B. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to Owner-occupied areas.
- C. Accompany Project Coordinator on preliminary final inspection.
- D. Notify Architect when work is considered finally complete.
- E. Complete items of work determined by Architect's final inspection.

END OF SECTION

SECTION 02-4100

DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of built site elements.

PART 3 EXECUTION

2.01 SCOPE

- A. Remove portions of existing building components:
 - 1. Metal roof deck.
 - 2. Ceiling mounted light fixtures.
 - 3. Ceiling mounted conduit. **(wall mounted conduit to remain).**
 - 4. HVAC equipment and electrical connection to unit.
 - 5. Ductwork from HVAC unit to the first elbow **(Horizontal ceiling supported duct to remain).**

2.02 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with applicable codes and regulations for demolition operations and safety of adjacent structures and the public.
 - 1. Obtain required permits.
 - 2. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 - 3. Provide, erect, and maintain temporary barriers and security devices.
 - 4. Conduct operations to minimize effects on and interference with adjacent structures and occupants.
- B. Protect existing structures and other elements that are not to be removed.
 - 1. Provide bracing and shoring.
- C. Hazardous Materials: Comply with 29 CFR 1926 and state and local regulations.
- D. Perform demolition in a manner that maximizes salvage and recycling of materials.
 - 1. Dismantle existing construction and separate materials.
 - 2. Set aside reusable, recyclable, and salvageable materials; store and deliver to collection point or point of reuse.

2.03 DEBRIS AND WASTE REMOVAL

- A. Remove debris, junk, and trash from site.
- B. Leave site in clean condition, ready for subsequent work.

END OF SECTION

SECTION 04-0100

MAINTENANCE OF MASONRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Replacement and resetting of terra cotta coping units.

1.02 PRICE AND PAYMENT PROCEDURES

- A. Bid shall be based on the quantity of work required as indicated on the drawings. Additional work required due to inspection and unacceptable condition of each additional coping unit will be on basis of change in cost to contract and will be proposed to owner before work commences.

1.03 QUALITY ASSURANCE

- A. Restorers:
 1. Lynchburg Restoration.
 2. Price Masonry.
 3. Purvis Masonry.

PART 2 PRODUCTS

2.01 MORTAR MATERIALS

- A. Portland Cement mortar with latex additive.
- B. Latex bonding agent.

2.02 MASONRY MATERIALS

- A. Terra Cotta: Units to match color and size of existing. Reclaimed units are acceptable.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces to be cleaned are ready for work of this section.

3.02 PREPARATION

- A. Inspect each coping segment for proper setting. Identify unacceptable units and notify architect for review prior to commencing work.
- B. Protect surrounding elements from damage due to restoration procedures.
- C. Remove all loose coping sections for cleaning and prepare surfaces to receive mortar with bonding agent.

3.03 REBUILDING

- A. Set terra cotta work to match and align with existing, with joints and coursing true and level, faces plumb and in line.

3.04 REPOINTING

- A. Repoint coping for loose units. Identify loose units and notify architect of condition and quantity of units prior to work.

3.05 SCHEDULES

- A. See drawings for quantity and location of coping work.

END OF SECTION

SECTION 05-3100

STEEL DECKING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Roof deck.

1.02 REFERENCE STANDARDS

- A. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2011.
- B. AWS D1.1/D1.1M - Structural Welding Code - Steel; American Welding Society; 2010.
- C. AWS D1.3 - Structural Welding Code - Sheet Steel; American Welding Society; 2008.
- D. SDI (DM) - Publication No.31, Design Manual for Composite Decks, Form Decks, Roof Decks; Steel Deck Institute; 2007.

1.03 SUBMITTALS

- A. See Section 01-3000 - Administrative Requirements, for submittals procedures.
- B. Shop Drawings: Indicate deck plan, support locations, pertinent details, and accessories.
- C. Product Data: Provide deck profile characteristics, dimensions, structural properties, and finishes.

1.04 QUALITY ASSURANCE

- A. Design deck layout, spans, fastening, and joints under direct supervision of a Professional Structural Engineer experienced in design of this work and licensed in the State in which the Project is located.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Steel Deck:
 - 1. Canam Steel Corporation: www.canam-steeljoists.ws.
 - 2. Nucor-Vulcraft Group: www.vulcraft.com.
 - 3. Wheeling Corrugating Co: www.wheelingcorrugating.com.
 - 4. Substitutions: See Section 01-6000 - Product Requirements.

2.02 STEEL DECK

- A. All Deck Types: Select and design metal deck in accordance with SDI Design Manual.
 - 1. Calculate to structural working stress design and structural properties specified.
 - 2. Maximum Vertical Deflection of Roof Deck: 1/240 of span.
- B. Roof Deck: Non-composite type, fluted steel sheet:
 - 1. Galvanized Steel Sheet: ASTM A653/A653M, Structural Steel (SS) Grade 33/230, with G90/Z275 galvanized coating.
 - 2. Minimum Metal Thickness, Excluding Finish: 22 gage.
 - 3. Nominal Height: 1-1/2 inch.

2.03 ACCESSORY MATERIALS

- A. Welding Materials: AWS D1.1.
- B. Fasteners: Galvanized hardened steel, self tapping.
- C. Miscellaneous accessories as required for a complete installation.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Erect metal deck in accordance with SDI Design Manual and manufacturer's instructions. Align and level.
- B. Weld deck in accordance with AWS D1.3.
- C. Immediately after welding deck and other metal components in position, coat welds, burned areas, and damaged surface coating, with touch-up primer.

END OF SECTION

SECTION 06-1000

ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Roofing nailers.
- B. Preservative treated wood materials.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Dimension Lumber: Comply with PS 20 and requirements of specified grading agencies.
 - 1. Species: Southern Pine, unless otherwise indicated.

2.02 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
 - 1. Lumber: S4S, No. 2 or Standard Grade.

2.03 ACCESSORIES

- A. Fasteners and Anchors:
 - 1. Metal and Finish: Hot-dipped galvanized steel per ASTM A 153/A 153M for high humidity and preservative-treated wood locations, unfinished steel elsewhere.
 - 2. Anchors: Expansion shield and lag bolt type for anchorage to solid masonry or concrete.

PART 3 EXECUTION

3.01 ROOF-RELATED CARPENTRY

- A. Coordinate installation of roofing carpentry with deck construction, framing of roof openings, and roofing assembly installation.
- B. Install blocking suitable for new roof flashing and gutter. Coordinate with EPDM roof membrane.
- C. Attach wood with adequate fasteners to prevent warp and displacement of blocking.

END OF SECTION

SECTION 07-0150.19

PREPARATION FOR RE-ROOFING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Removal of existing roofing system in preparation for a new roof membrane system.

1.02 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate with affected mechanical and electrical work associated with roof penetrations.
- B. Preinstallation Meeting: Convene one week before starting work of this section.
- C. Schedule work to coincide with commencement of installation of new roofing system.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Materials as deemed necessary by contractor for protection and weather-tightness of interior spaces.

PART 3 EXECUTION

3.01 MATERIAL REMOVAL

- A. Remove metal counter flashings.
- B. Remove insulation and fasteners, cant strips, blocking.

END OF SECTION

SECTION 07-5300

ELASTOMERIC MEMBRANE ROOFING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Elastomeric roofing membrane, adhered conventional application.
- B. Insulation, flat.
- C. Flashings.
- D. Roofing stack boots.
- E. Recovery board at parapet walls.

1.02 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Convene a preinstallation meeting one week before starting work of this section; require attendance by all affected installers; review preparation and installation procedures and coordination and scheduling necessary for related work.

1.03 SUBMITTALS

- A. See Section 01-3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data indicating membrane materials, flashing materials and insulation.
- C. Manufacturer's Installation Instructions: Indicate membrane seaming precautions and perimeter conditions requiring special attention.
- D. Warranty: Submit manufacturer warranty and ensure forms have been completed in Owner's name and registered with manufacturer.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with NRCA Roofing and Waterproofing Manual and manufacturer's instructions.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum 10 years of documented experience.
- C. Applicator Qualifications: Company specializing in performing the work of this section with minimum 10 years experience and approved by manufacturer.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products in manufacturer's original containers, dry, undamaged, with seals and labels intact.
- B. Store products in weather protected environment, clear of ground and moisture.
- C. Protect foam insulation from direct exposure to sunlight.

1.06 FIELD CONDITIONS

- A. Do not apply roofing membrane during unsuitable weather.
- B. Do not apply roofing membrane to damp or frozen deck surface or when precipitation is expected or occurring.

1.07 WARRANTY

- A. Correct defective Work within a two year period after Date of Substantial Completion.
- B. Provide twenty year manufacturer's material and labor warranty to cover failure to prevent penetration of water.

- C. Provide manufacturer's roof damage warranty as standard with installation of a reinforced membrane.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. EPDM Membrane Materials:
 - 1. Carlisle SynTec: www.carlisle-syntec.com.
 - 2. Firestone Building Products Co: www.firestonebpco.com.
 - 3. GenFlex Roofing Systems: www.genflex.com.
- B. Insulation:
 - 1. Any manufacturer approved by roof membrane manufacturer.

2.02 ROOFING

- A. Elastomeric Membrane Roofing: One ply membrane, fully adhered, over insulation.
- B. Acceptable Insulation Types - Constant Thickness Application:
 - 1. Minimum 2 layers of polyisocyanurate board.
- C. Acceptable Insulation Types - Tapered Application:
 - 1. Tapered polyisocyanurate board.

2.03 ROOFING MEMBRANE AND ASSOCIATED MATERIALS

- A. Membrane: Ethylene-propylene-diene-terpolymer (EPDM); internally reinforced with fabric or scrim.
 - 1. Thickness: 0.060 inch.
 - 2. Color: Black.
- B. Seaming Materials: As recommended by membrane manufacturer.
- C. Membrane Fasteners: As recommended by and approved by membrane manufacturer.
- D. Flexible Flashing Material: Same material as membrane; conforming to the following:
 - 1. Thickness: 0.60 mil.
 - 2. Color: Black.

2.04 INSULATION

- A. Polyisocyanurate Board Insulation: Rigid cellular foam, complying with ASTM C1289, and with the following characteristics:
 - 1. Compressive Strength: 16 psi
 - 2. Board Thickness: 2 layers for a total of 4 inch.
 - 3. Thermal Resistance: R-value of 25.
 - 4. Manufacturer: As approved by roof membrane manufacturer.

2.05 ACCESSORIES

- A. Stack Boots: Prefabricated flexible boot and collar for pipe stacks through membrane; same material as membrane.
 - 1. Use 2- piece split boot for existing mechanical post, piping and conduits.
- B. Insulation Fasteners: Appropriate for purpose intended and approved by roofing manufacturer.
- C. Membrane Adhesive: As recommended by membrane manufacturer.
- D. Recovery Board: DensDeck by Georgia-Pacific.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces and site conditions are ready to receive work.

- B. Verify deck is clean and smooth, flat, free of depressions, waves, or projections, properly sloped and suitable for installation of roof system.
- C. Verify deck surfaces are dry and free of snow or ice.
- D. Verify that roof openings, curbs, and penetrations through roof are solidly set, and nailing strips and reglets are in place.

3.02 PARAPET PREPARATION

- A. Attached recovery board to the existing masonry with non-corrosive tapping screws.

3.03 INSULATION - UNDER MEMBRANE

- A. Attachment of Insulation:
- B. Attachment of Insulation: Mechanically fasten insulation to deck in accordance with roofing manufacturer's instructions.
- C. Lay subsequent layers of insulation with joints staggered minimum 6 inch from joints of preceding layer.
- D. Place tapered insulation to the required slope pattern in accordance with manufacturer's instructions.
- E. Lay boards with edges in moderate contact without forcing. Cut insulation to fit neatly to perimeter blocking and around penetrations through roof.
- F. Do not apply more insulation than can be covered with membrane in same day.

3.04 MEMBRANE APPLICATION

- A. Roll out membrane, free from wrinkles or tears. Place sheet into place without stretching.
- B. Shingle joints on sloped substrate in direction of drainage.
- C. Fully Adhered Application: Fully embed membrane in adhesive except in areas directly over or within 3 inches of expansion joints. Fully adhere one roll before proceeding to adjacent rolls.
- D. At intersections with vertical surfaces:
 - 1. Fully adhere flexible flashing over membrane and up to batten bar and flashing.
- E. Around roof penetrations, seal flanges and flashings with flexible flashing.
- F. Coordinate installation of associated counterflashings installed under other sections.

3.05 PROTECTION

- A. Protect installed roofing and flashings from construction operations.
- B. Where traffic must continue over finished roof membrane, protect surfaces using durable materials.

END OF SECTION

SECTION 07-6200

SHEET METAL FLASHING AND TRIM

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items for the masonry building, including flashings, counterflashings, gutters, and downspouts.
- B. Sealant.

1.02 RELATED REQUIREMENTS

- A. Section 06-1000 - Rough Carpentry: Wood blocking.
- B. Section 07-4113 Metal Roof Panels: Gutters and Downspouts as part of roof system.

1.03 SUBMITTALS

- A. See Section 01-3000 - Administrative Requirements, for submittal procedures.
- B. Samples: Submit two samples 2x3 inch in size illustrating metal finish color.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA Architectural Sheet Metal Manual requirements, except as otherwise indicated.

PART 2 PRODUCTS

2.01 SHEET MATERIALS

- A. Pre-Finished Galvanized Steel: ASTM A653/A653M, with G90/Z275 zinc coating; minimum 0.02 inch thick base metal, shop pre-coated with PVDF coating.
 - 1. PVDF (Polyvinylidene Fluoride) Coating: Superior Performance Organic Finish, AAMA 2605; multiple coat, thermally cured fluoropolymer finish system.
 - 2. Color: As selected by Architect from manufacturer's standard colors.

2.02 ACCESSORIES

- A. Fasteners: Galvanized steel.(neoprene washers where exposed fasteners can only be used). Drilled and adhesive type at limestone coping.
- B. Sealant: Polyurethane or silicone as recommended by roof installer.

2.03 FABRICATION

- A. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- B. Form pieces in longest possible lengths.
- C. Hem exposed edges on underside 1/2 inch; miter and seam corners.
- D. Form material with flat lock seams, except where otherwise indicated. At moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- E. Fabricate vertical faces with bottom edge formed outward 1/4 inch (6 mm) and hemmed to form drip.
- F. Cleats formed to conceal fasteners and shall be continuous.

2.04 GUTTER AND DOWNSPOUT FABRICATION

- A. Gutters: SMACNA Architectural Sheet Metal Manual, Rectangular profile.
- B. Downspouts: Rectangular profile.
- C. Gutters and Downspouts: Size indicated.

COL Task 7
Storage Building at Former A-M Site

- D. Accessories: Profiled to suit gutters and downspouts.
 - 1. Gutter Supports: Brackets.
 - 2. Downspout Supports: Straps.
- E. Seal metal joints.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify roofing termination and base flashings are in place, sealed, and secure.

3.02 INSTALLATION

- A. Secure flashings in place using concealed fasteners. Use exposed fasteners only where permitted.
- B. Fit flashings tight in place. Make corners square, surfaces true and straight in planes, and lines accurate to profiles.
- C. Seal metal joints watertight.
- D. Apply sealants to joints that can not be sealed by any other means.
- E. Secure gutters and downspouts in place using fasteners.
- F. Slope gutters 1/8 inch per foot minimum.

END OF SECTION

SECTION 09-9000

PAINTING AND COATING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation. Sandblasting of steel and power washing of masonry walls and concrete floor.
- B. Painting of steel joist, deck, columns, conduits and sprinkler piping.

1.02 SUBMITTALS

- A. See Section 01-3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of all products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide all paint and coating products used in any individual system from the same manufacturer; no exceptions.
- B. Paints:
 - 1. Base Manufacturer: Sherwin-Williams Company: www.sherwin-williams.com..
 - 2. Duron, Inc: www.duron.com.
 - 3. Glidden Professional: www.gliddenprofessional.com.
 - 4. Benjamin Moore & Co: www.benjaminmoore.com.
 - 5. PPG Architectural Finishes, Inc: www.ppgaf.com.
 - 6. Pratt & Lambert Paints: www.prattandlambert.com.
- C. Substitutions: See Section 01-6000 - Product Requirements.

2.02 PAINTS AND COATINGS - GENERAL

- A. Paints and Coatings: Ready mixed, unless intended to be a field-catalyzed coating.
 - 1. Provide materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.
 - 2. Do not reduce, thin, or dilute coatings or add materials to coatings unless such procedure is specifically described in manufacturer's product instructions.
- B. Colors: As indicated on drawings

2.03 PAINT SYSTEMS - INTERIOR

- A. All Interior Surfaces Indicated to be Painted, Unless Otherwise Indicated: Including uncoated steel, shop primed steel, and galvanized steel.
 - 1. Primer(s): As recommended by manufacturer of top coats.
- B. Dry Fall: Metals; exposed structure and overhead-mounted services, including shop primed steel deck, structural steel, metal fabrications, galvanized conduit, galvanized piping, and other miscellaneous metals.
 - 1. One top coat unless bleed through shows. Add additional coats to provide a opaque white finish throughout ceiling structure.
 - 2. Flat: MPI gloss level 1; use this sheen at ceiling.
 - 3. Semi-Gloss: MPI gloss level 5; use this sheen at columns.
 - 4. Top Coat Product(s):
 - a. Sherwin-Williams Dryfall Flat.

- b. Sherwin-Williams Super Save-Lite Dryfall, Gloss VOC Complying. (not MPI)
 - 1) Contractor Option: Sherwin-Williams Pro Industrial Pre-Catalyzed Waterbased Epoxy. (gloss 5)
- c. Or equal products.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to coating application.
 - 1. Surfaces to be cleaned and prepared are as follows:
 - a. Steel joists, beams, columns and fire sprinkler line: Abrasive blast to remove surface rust.
 - b. Steel deck: New deck shall be cleaned to remove any oils, dirt and films.
 - c. Masonry block walls: Power wash to remove mildew, dirt and oils. Use TSP and bleach as required to remove mildew. (No painting required at masonry walls).
 - d. Concrete floor: Steam clean to remove oils and grease. (Owner understands that some grease and oils will not be removed and expect only a reasonable cleaning since floor will be left unfinished and used only for utilitarian use).
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Mask walls and other items not to be painted.
- D. Seal surfaces that might cause bleed through or staining of topcoat.

3.02 APPLICATION

- A. Apply products in accordance with manufacturer's instructions.
- B. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- C. Apply each coat to uniform appearance.

END OF SECTION

**Appendix Photos for
Task 7: Storage Building - Allen Morrison Site**



Photo 1.JPG



Photo 2.JPG



Photo 3.JPG



Photo 4.JPG



Photo 5.JPG



Photo 6.JPG

**Appendix Photos for
Task 7: Storage Building - Allen Morrison Site**



Photo 7.JPG



Photo 8.JPG



Photo 9.JPG



Photo 10.JPG



Photo 11.JPG



Photo 12.JPG

**Appendix Photos for
Task 7: Storage Building - Allen Morrison Site**



Photo 13.JPG



Photo 14.JPG



Photo 15.JPG



Photo 16.JPG



Photo 17.JPG

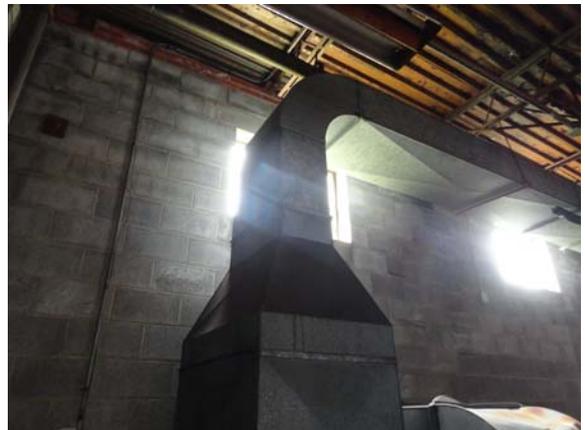


photo 18.JPG

**Appendix Photos for
Task 7: Storage Building - Allen Morrison Site**



Photo 19.JPG



Photo 20.JPG

ROOF REPLACEMENT FOR TASK 7: STORAGE BUILDING AT FORMER ALLEN MORRISON SITE

300 RUTHERFORD STREET LYNCHBURG, VIRGINIA

CITY BUILDING NUMBER: PR828

ARCHITECT

CRADDOCK CUNNINGHAM
ARCHITECTURAL PARTNERS P.C.

10 NINTH STREET
LYNCHBURG, VA 24504
phone: (434) 846-8456
fax: (434) 846-4534
email: info@ccappp.com
contact person: Mark Smith, Architect
direct email: mark@ccappp.com


OWNER

CITY OF LYNCHBURG, VA
PUBLIC WORKS DEPARTMENT

BUILDINGS & GROUNDS DIVISION
800 ORCHARD STREET
LYNCHBURG, VA 24501
phone: (434) 455-4407
fax: (434) 845-1813
email: Randy.Dalton@lynchburgva.gov
contact person: Randy Dalton

DRAWING LIST

CS1.1 Cover Sheet
A1.1 Roof Plan and Details

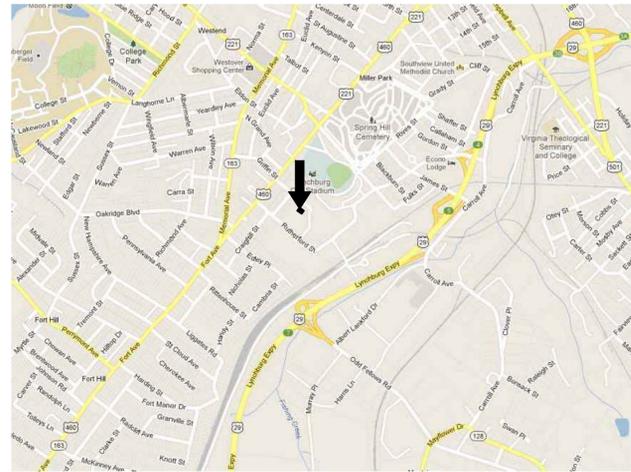

VICINITY MAP



SITE MAP




ABBREVIATIONS

AB ANCHOR BOLT	DET DETAIL(ED)	GRG GRATING	LLV LONG LEG VERTICAL	FLYND FLYWOOD	STC SOUND TRANSMISSION COEFFICIENT
ABV ABOVE	DIA DIAMETER	GWB GYPSUM WALLBOARD	LOC LOCATION	PNLG PANELING	STD STANDARD
ACST ACOUSTIC	DIAG DIAGONAL, DIAGRAM	GYP GYPSUM	LONS LONGitudINAL	FR PAIR	STL STEEL
ACT ACOUSTICAL CEILING TILE	DIM DIMENSION	H HEIGHT, HIGH	LPT LOW POINT	PSF POUNDS PER SQUARE FOOT	STO STORAGE
AF ABOVE FINISHED FLOOR	DK DECK	HB HOSE BIBB	MACH MACHINE	PSI POUNDS PER SQUARE INCH	STRUCT STRUCTURAL
AGR AGGREGATE	DN DOWN	HEP HARDWARE	MT MATERIAL	PT PRESSURE TREATED, POINT, POINT OF TANG.	SUSP SUSPENDED
AHR ANCHOR	DOH DOOR OPENING HEIGHT	HC HANDICAPPED	MATL MATERIAL	PTN PARTITION	SYM SYMMETRICAL
AL ALUMINUM	DOH DOOR OPENING WIDTH	HDN HARDWARE	MAX MAXIMUM	PVC POLYVINYL CHLORIDE, POINT OF VERTICAL CURVE	SYS SYSTEM
APC ARCHITECTURAL PRECAST	DP DAMPROOFING	HWD HARDWOOD	MCT MARMOLEUM COMPOSITE TILE	QT QUARRY TILE	TEL TELEPHONE
APPROX APPROXIMATE	DR DOOR	HM HOLLOW METAL	MDF MEDIUM DENSITY FIBERBOARD	R RADIUS, REACTION, RISER, RESISTANCE	T&G TONGUE AND GROOVE
ARCH ARCHITECTURAL	DS DOWNSPOUT	HMD HOLLOW METAL DOOR	MECH MECHANICAL	RA RETURN AIR	THK THICKNESS
AVG AVERAGE	DWG DRAWING	HMF HOLLOW METAL FRAME	MEZZ MEZZANINE	RA RESILIENT ATHLETIC FLOORING	THR THRESHOLD
BD BOARD	EA EACH	HOR HORIZONTAL	MFR MANUFACTURER	RCP REFLECTED CEILING PLAN	TOS TOP OF JOIST
BET BETWEEN	EJFS EXTERIOR INSULATION FINISH SYSTEM	HPT HIGH POINT	MIN MINIMUM	RCPT RECEPTACLE(S)	TOS TOP OF STEEL
BLDG BUILDING	EJ EXPANSION JOINT	HR HANDRAIL	MISC MISCELLANEOUS	RD ROOF DRAIN	TOT TOTAL
BLK BLOCKING	EL ELEVATION	HT HEIGHT	NO MASONRY OPENING	REF REFERENCE	TRD TREAD
BM BEAM	ELEC ELECTRICAL	HVAC HEATING, VENTILATING & AIR CONDITIONING	MOH MASONRY OPENING HEIGHT	REINF REINFORCE(MENT) (ING)	TRTD TREATED
BOT BOTTOM	ELEV ELEVATOR, ELEVATION	HW HOT WATER	MOW MASONRY OPENING WIDTH	REQD REQUIRED	T/STAT THERMOSTAT
BRG BEARING	ENCL ENCLOSE(URE)	IVC INSIDE DIAMETER	NT NOUNT	REQMT REQUIREMENT(S)	TYP TYPICAL
BUR BUILT-UP ROOF(ING)	EG EQUAL	IN INCH	MTL METAL	RESIL RESILIENT	UN UNLESS OTHERWISE NOTED
C/C CENTER TO CENTER	EGPT EQUIPMENT	INCL INCLUSIVE	MUL MULLION	RET RETURN	UTIL UTILITY
CIP CAST-IN-PLACE, CAST IRON PIPE	ENC ELECTRIC WATER COOLER	INSTL INSTALL(ED)	MMP MEMBRANE WATERPROOFING	REV REVERSE ACTING, REVISED, REVISION	VCT VINYL COMPOSITION TILE
CJ CONTROL JOINT	EXH EXHAUST	INSUL INSULATE(ED) (ING) (ION)	N NORTH	RF RETURN FAN, ROOF	VENT VENTILATE
CL CENTER LINE	EXIST EXISTING	INT INTERIOR	NIC NOT IN CONTRACT	RGD RETURN GRILLE	VERT VERTICAL
CFS COLD FORMED STEEL	EXP EXPOSED	INTMD INTERMEDIATE	NO NUMBER	RM ROOM	VEST VESTIBULE
CFMF COLD FORMED METAL FRAMING	EXPN EXPANSION	ISOL ISOLATION	NOM NOMINAL	RO ROUGH OPENING	VIF VERIFY IN FIELD
CLG CEILING	EXT EXTERIOR	JAN JANITOR	NST NONSLIP TREAD	RJ ROLL UP	VNR VENEER
CLR CLEAR	F4M FLASHING & KEEPS	JST JOIST	NTS NOT TO SCALE	S SOLID, SOUTH, SWITCH	VTR VENT THRU ROOF
CMU CONCRETE MASONRY UNIT	FD FLOOR DRAIN	JT JOINT(S), JOYER TRANSMITTER	OAH OVERALL HEIGHT	SA STATUS ALARM, SUPPLY AIR	VWG VINYL WALL COVERING
COL COLUMN	FDN FOUNDATION	KCP KNOCKOUT PANEL	OC ON CENTER	SCHF STEEL CHANNEL FRAME	W/ WITH
COMP COMPOSITE	F/F FACE TO FACE	L LENGTH, LINE, LONG	OD OUTSIDE DIAMETER	SCHED SCHEDULE	WC WATER CLOSET, WATER COLUMN
CONC CONCRETE, CONCENTRATED	F1N FINISH(ED)	LAB LABORATORY	OPC1 OWNER FURNISHED CONTRACTOR INSTALLED	SECT SECTION	WD WINDOW
CONN CONNECT(ED), CONNECTION	FL FLOOR	LAM LAMINATE	OPF1 OWNER FURNISHED OWNER INSTALLED	SF SQUARE FEET (FOOT)	N/O NOT OUT
CONSTR CONSTRUCTION	FRFP FIBERGLASS REINFORCED POLYESTER	LAV LAVATORY	OFF OFFICE	S6 SUPPLY GRILLE	NOH WINDOW OPENING HEIGHT
CONT CONTINUATION, CONTINUOUS, CONTROL	FT FOOT(FEET)	LB POUND	OFF OVERHEAD	SGF STRUCTURAL GLAZED FACING UNITS	NOH WINDOW OPENING WIDTH
CONTR CONTRACT, CONTRACTOR	FRT FIRE RETARDANT TREATED	LF LINEAR FOOT	OPN OPENING	SH SHEET	NP WEATHERPROOF, NORKING POINT
COORD COORDINATE	FTG FOOTING	L6 LENGTH, LONG	OPP OPPOSITE	SIM SIMILAR	NWB WATER RESISTANT GYPSUM WALLBOARD
CORR CORRIDOR, CORRUGATED	FUT FUTURE	LIN LINEAR	O/O OUT TO OUT	SNT SEALANT	NWF WELDED WIRE FABRIC
CT CERAMIC TILE	GA GAGE	LL LIVE LOAD	P1 PERIMETER INSULATION	SPEC SPECIFICATION(S)	N NEST
CTNG COATING	GAL GALLON	LLH LONG LEG HORIZONTAL	PL PLATE	SPEFI SPRAY POLYURETHANE FOAM INSULATION	
CTR CENTER	GALV GALVANIZE(D)		PL PROPERTY LINE	SPM SINGLE PLY MEMBRANE	
COUNTERSUNK	GL GLASS		PLAS PLASTIC LAMINATE	SQ SQUARE	
DEPTH, DEEP			PLAS PLASTER	SST STAINLESS STEEL	

SYMBOL LEGEND

	PRE CAST ARCHITECTURAL CONCRETE "APC"		FINISH WOOD
	GYPSUM WALLBOARD		PLYWOOD
	BRICK OR MASONRY VENEER		CONCRETE
	CONCRETE MASONRY UNITS "CMU"		CRUSHED STONE BASE MATERIAL
	RIGID INSULATION		EARTH
	BATT INSULATION		STEEL
	COLUMN TAG		ELEVATION MARKER
	WALL TYPE TAG		DOOR TAG
	GENERAL NOTE TAG		DETAIL REFERENCE SYMBOL
	LOUVER TAG		SECTION REFERENCE SYMBOL
	WINDOW TAG		SECTION REFERENCE SYMBOL 2
	ELEVATION NUMBER		
	INTERIOR ELEVATION MARKER		
	FINISH SCHEDULE TAG		



WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND THIS OFFICE MUST BE NOTIFIED OF ANY VARIATION FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS.

DESIGNED: MWS
DRAWN: TCC
CHECKED: MWS
DATE: 2013-05-21
REVISIONS:

COVER SHEET

CS1.1

