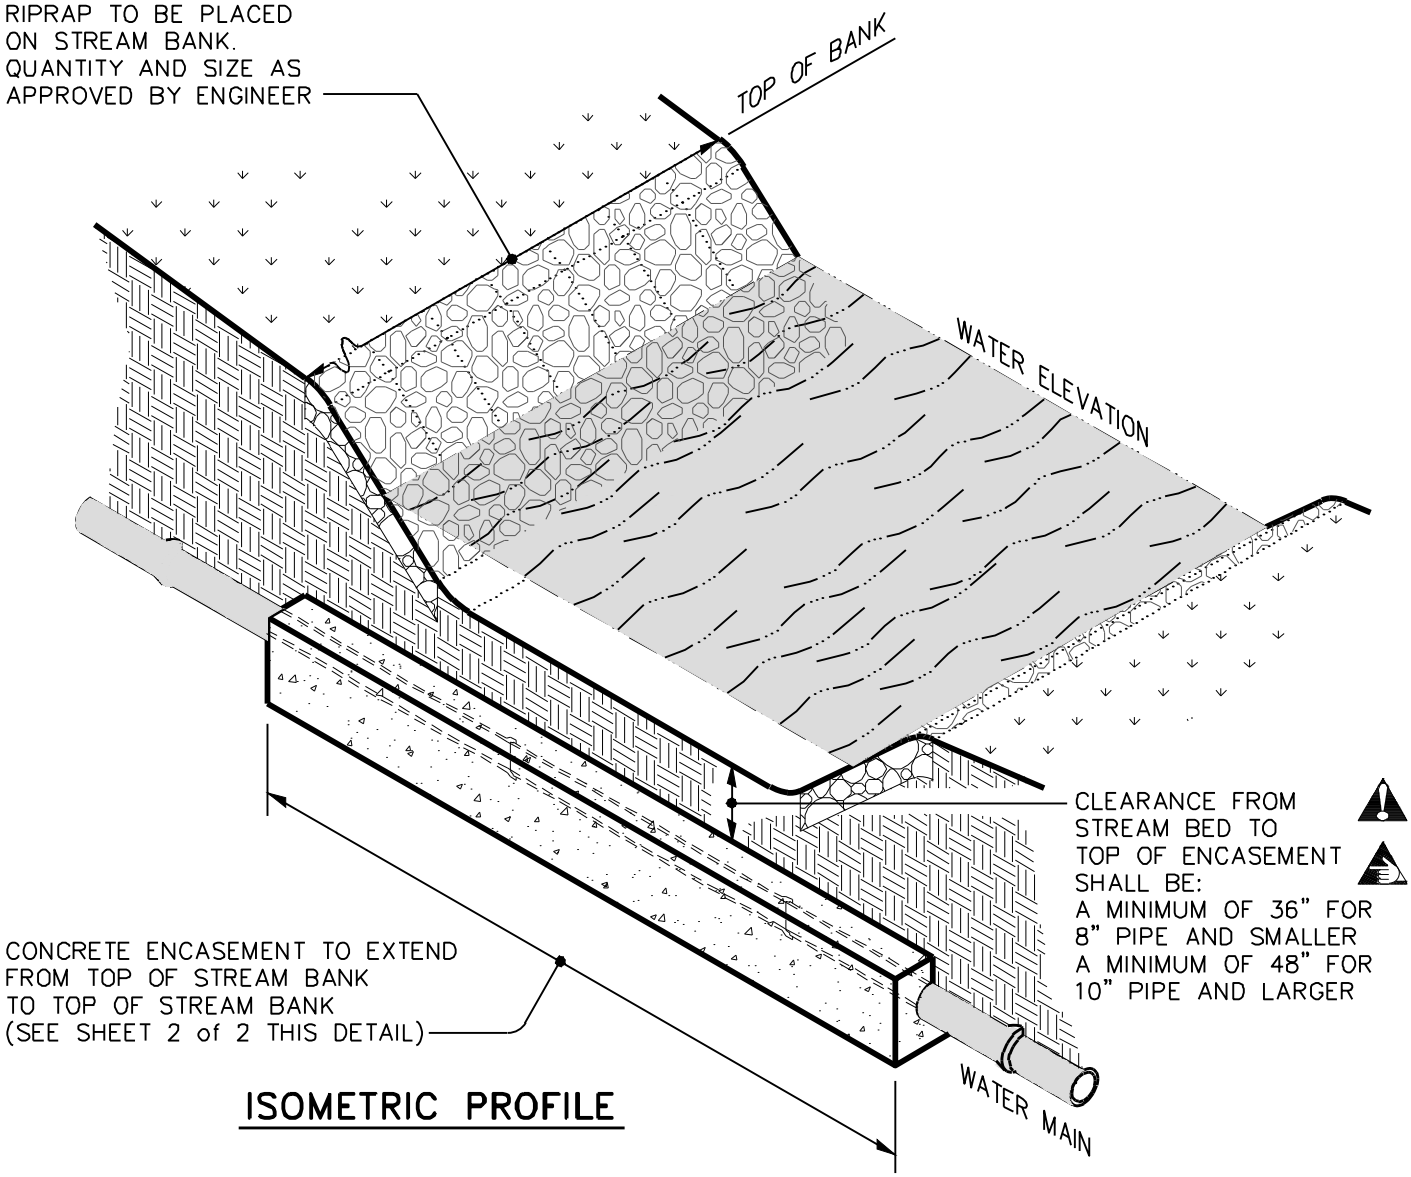

ISOMETRIC PROFILE

NOTES:

1. CONCRETE TO BE 3000 PSI.
2. ENCASEMENT TO BE USED ONLY WHERE SPECIFIED ON PLANS.
3. PIPE SHALL BE DUCTILE IRON PIPE.
4. FILTER FABRIC TO BE PLACED UNDER RIP-RAP AND KEYED INTO EMBANKMENT.

THE CITY OF LYNCHBURG			
WATER LINE CROSSING BENEATH STREAM BED	SCALE: NOT TO SCALE	DETAIL # 26.22	
	REVISION DATE: 12-12-2014	SHEET #: 1 OF 2	
USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY			