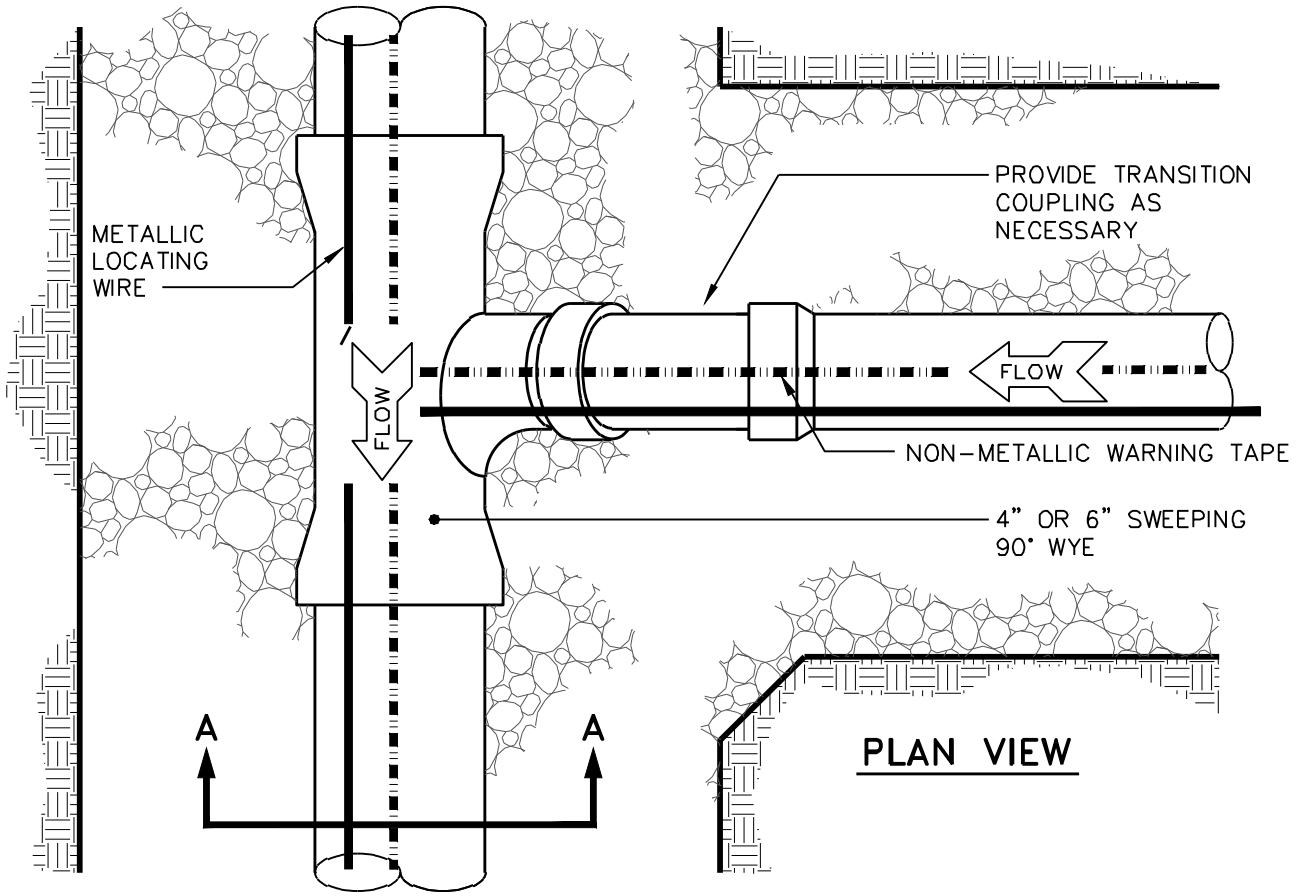

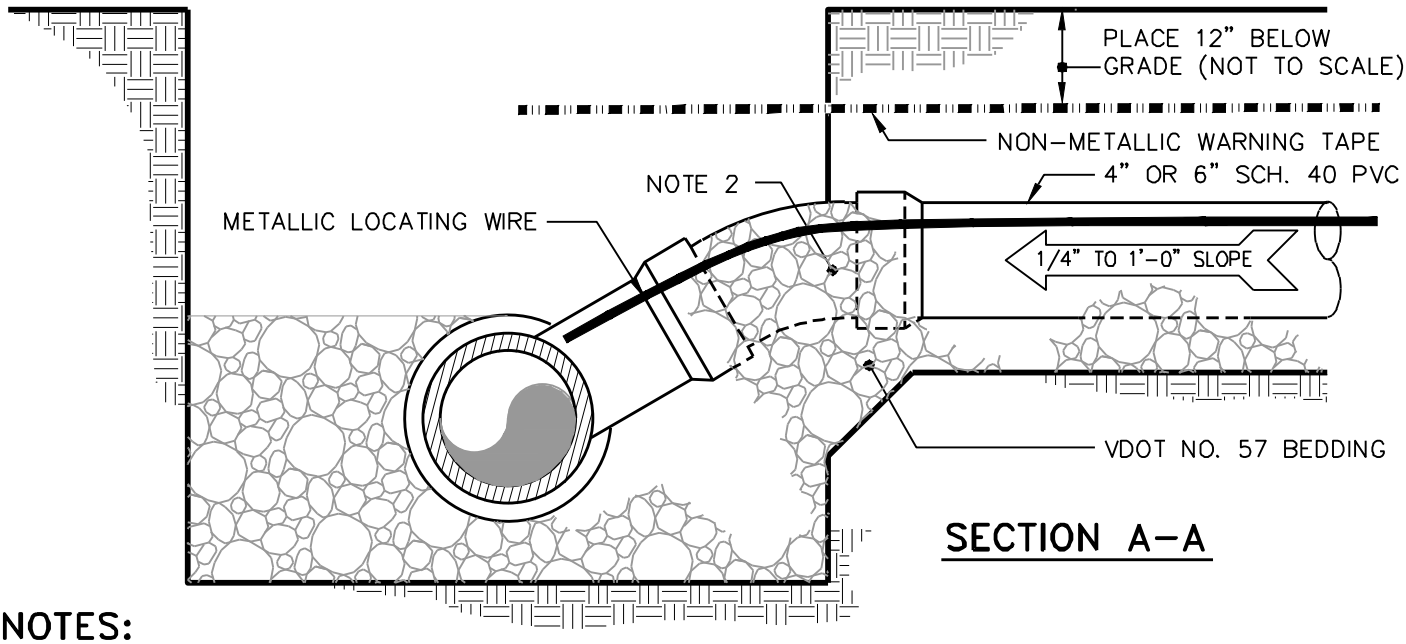

NOTES:

1. STONE SHALL BE INSTALLED TO TOP OF PIPE FOR PVC PIPE.
   STONE SHALL BE INSTALLED TO D/8 FOR DI PIPE.
2. NON-METALLIC WARNING TAPE AND METALLIC LOCATING WIRE REQ'D. ALONG ENTIRE LENGTH OF LATERAL AND MAIN PER SPECIFICATION 02220, PARAGRAPH 3.9.1A.

THE CITY OF LYNCHBURG			
BUILDING CONNECTION HORIZONTAL WYE	SCALE: NOT TO SCALE	DETAIL # 27.14	
	REVISION DATE: 12-12-2014	SHEET #: 1 OF 1	
USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY			