


PLAN VIEW

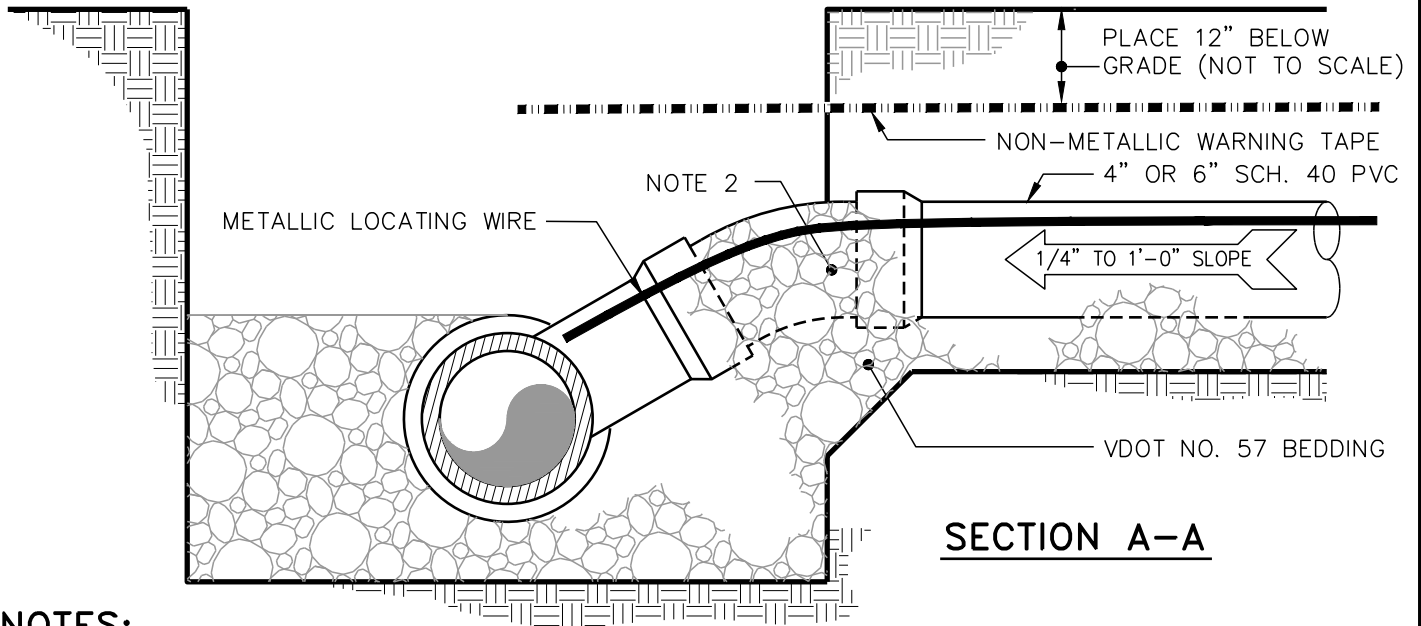

SECTION A-A

NOTES:

1. STONE SHALL BE INSTALLED TO TOP OF PIPE FOR PVC PIPE.
STONE SHALL BE INSTALLED TO D/8 FOR DI PIPE.
2. NON-METALLIC WARNING TAPE AND METALLIC LOCATING WIRE REQ'D. ALONG ENTIRE LENGTH OF LATERAL AND MAIN PER SPECIFICATION 02220, PARAGRAPH 3.9.1A.



THE CITY OF LYNCHBURG

**BUILDING CONNECTION
HORIZONTAL WYE**

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:
NOT TO SCALE

DETAIL #
27.14

REVISION DATE:
12-15-2016

SHEET #:
1 OF 1