


ABANDON EXISTING SEPTIC TANK AND DRAIN FIELD

LOW PRESSURE SEWER UNIT AND CONTROL PANEL

CONNECT TO NEW PUMP UNIT DRAIN LINES

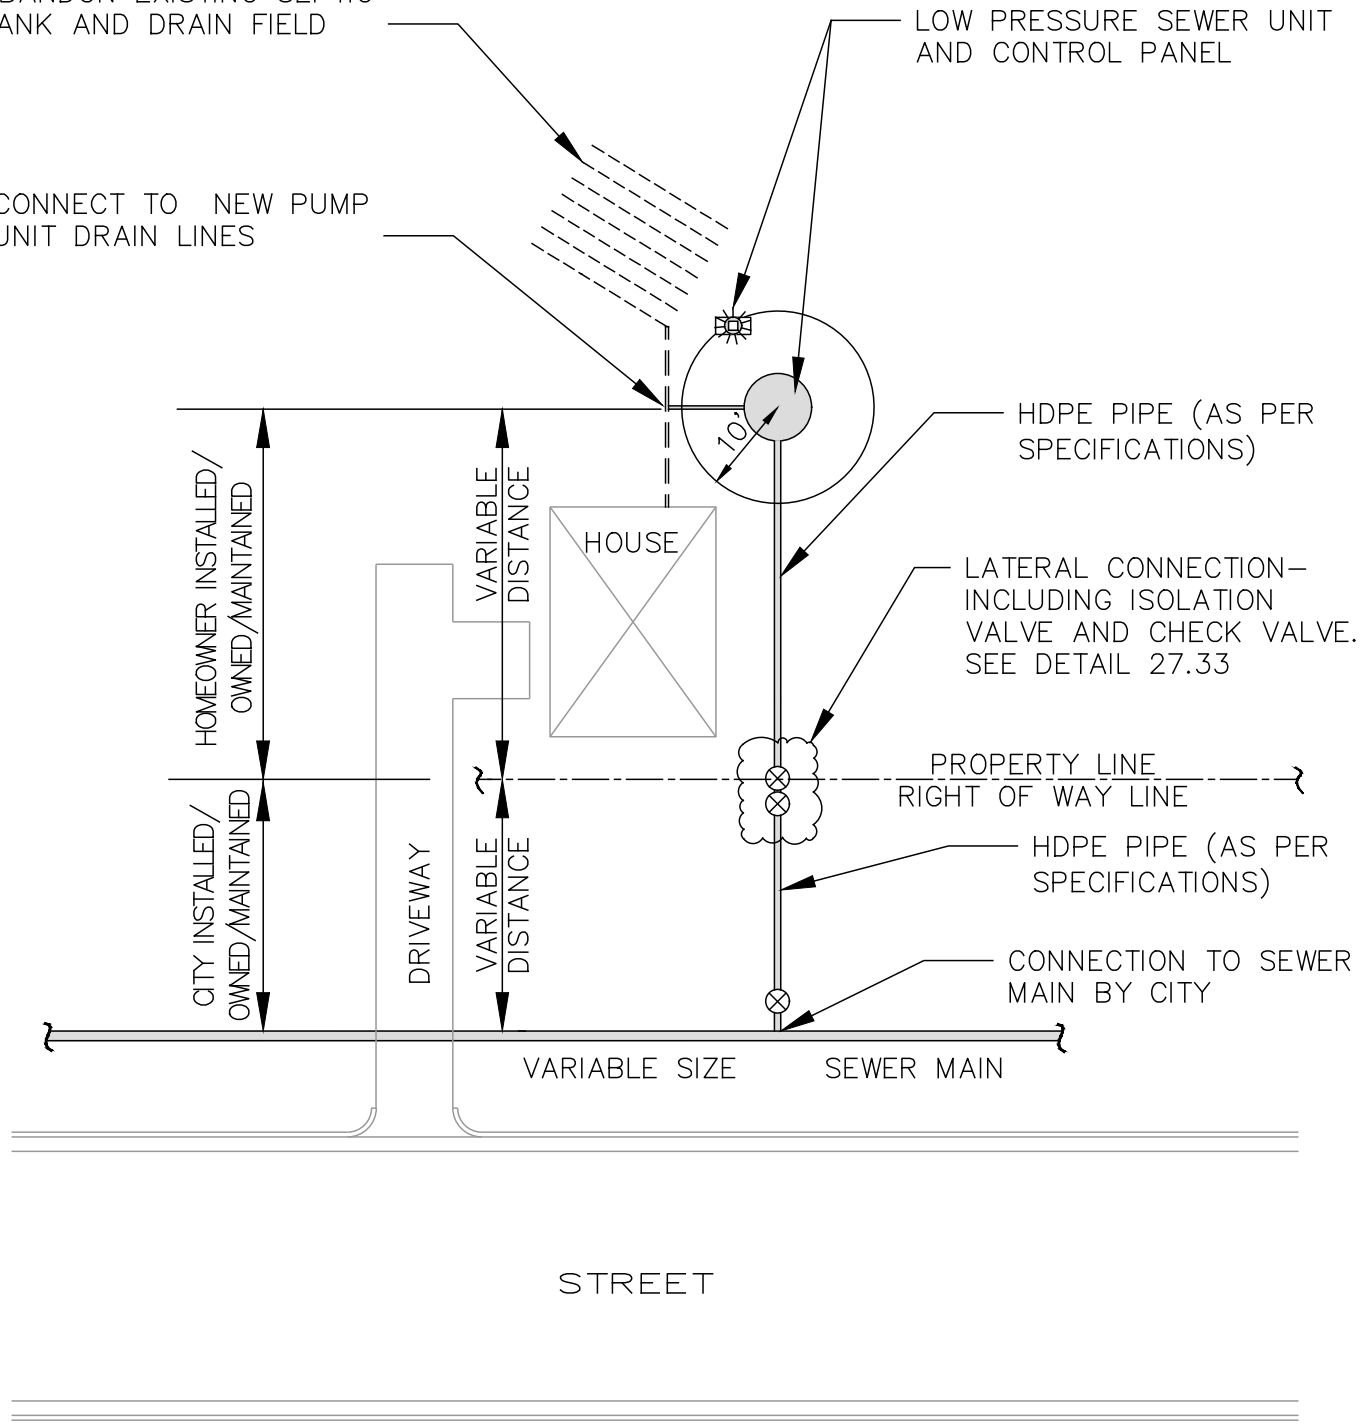

STREET

VARIABLE SIZE SEWER MAIN

CONNECTION TO SEWER MAIN BY CITY

HDPE PIPE (AS PER SPECIFICATIONS)

PROPERTY LINE  
RIGHT OF WAY LINE

LATERAL CONNECTION—  
INCLUDING ISOLATION  
VALVE AND CHECK VALVE.  
SEE DETAIL 27.33

HDPE PIPE (AS PER  
SPECIFICATIONS)

HOMEOWNER INSTALLED/  
OWNED/MAINTAINED

CITY INSTALLED/  
OWNED/MAINTAINED


VARIABLE  
DISTANCE

VARIABLE  
DISTANCE

DRIVEWAY



HOUSE



10'

5/03/2017 - 11:40:23am



### THE CITY OF LYNCHBURG

## LPFM – COMPONENT LOCATION

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:  
NOT TO SCALE

DETAIL #  
**27.24**

REVISION DATE:  
12-15-2016

SHEET #:  
1 OF 1