

PROPERTY LINE



DOMESTIC SERVICE REDUCED PRESSURE PRINCIPLE (RP) BACKFLOW PREVENTION ASSEMBLIES AS REQUIRED SHALL BE ASSE 1013 AND USC APPROVED, AND 0.25% LEAD FREE.

IRRIGATION SERVICE REDUCED PRESSURE PRINCIPLE (RP) BACKFLOW PREVENTION ASSEMBLIES AS REQUIRED SHALL BE ASSE 1013 AND USC APPROVED, AND 0.25% LEAD FREE.


FIRE SERVICE REDUCED PRESSURE PRINCIPLE (RP)\* BACKFLOW PREVENTION ASSEMBLIES SHALL BE ASSE 1013 AND USC APPROVED, AND 0.25% LEAD FREE.

DOMESTIC AND/OR IRRIGATION RP'S MAY BE INSTALLED IN ASSE 1060 ENCLOSURE WITH FIRE RP\*, AS LONG AS THEY ARE INSTALLED WITH THE ALLOWANCES WHICH ARE REQUIRED AROUND EACH ASSEMBLY.

FROM CITY WATER MAIN

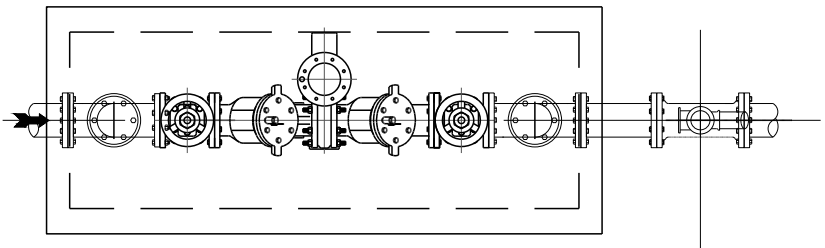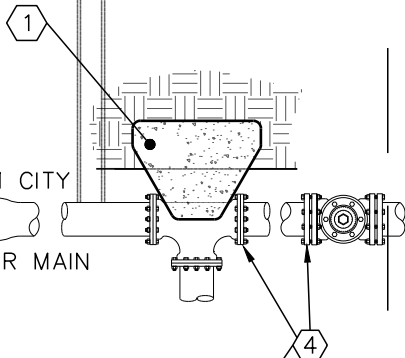


4'X4'X4" CONCRETE PAD

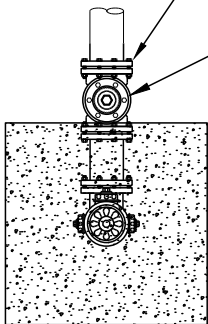

FIRE HYDRANT REQUIRED IF FIRE DEPARTMENT CONNECTION IS GREATER THAN 50' FROM NEAREST CITY FIRE HYDRANT. (SEE CITY STANDARD DETAIL 26.09)

ABOVE GROUND ENCLOSURE ASSE 1060

4" THICK CONC. PAD

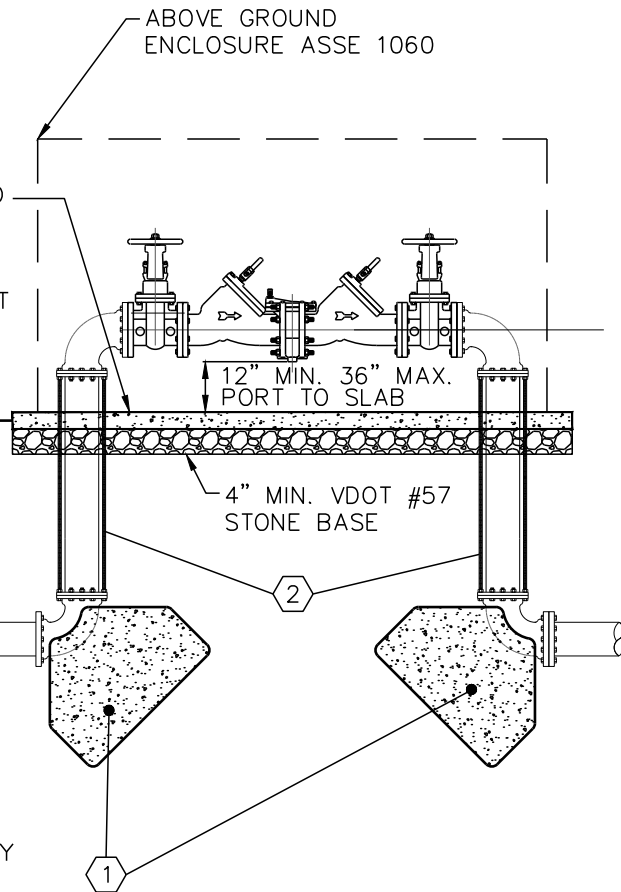

MAINTAIN MIN. COVER AS SHOWN ON DETAIL 26.01

\*IF THE OWNER OR CUSTOMER WISHES TO MONITOR THEFT FROM PRIVATE FIRE HYDRANTS OR UNDERGROUND LEAKS, A REDUCED PRESSURE PRINCIPLE DETECTOR ASSEMBLY (RPDA), ASSE 1047, WHICH IS USC APPROVED, AND 0.25% LEAD FREE, MAY BE USED INSTEAD OF A RP.



# THE CITY OF LYNCHBURG

RP\*—FOR INDEPENDENT FIRE SERVICE OR PRIVATE HYDRANT INSTALLATION WITH DOMESTIC AND IRRIGATION SERVICES

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:  
NOT TO SCALE

REVISION DATE:  
4-2020

DETAIL #  
26.20B

SHEET #:  
1 OF 3