


RIPRAP TO BE PLACED ON STREAM BANK. QUANTITY AND SIZE AS APPROVED BY ENGINEER



CLEARANCE FROM STREAM BED TO TOP OF ENCASEMENT SHALL BE:  
 A MINIMUM OF 36" FOR 8" PIPE AND SMALLER  
 A MINIMUM OF 48" FOR 10" PIPE AND LARGER

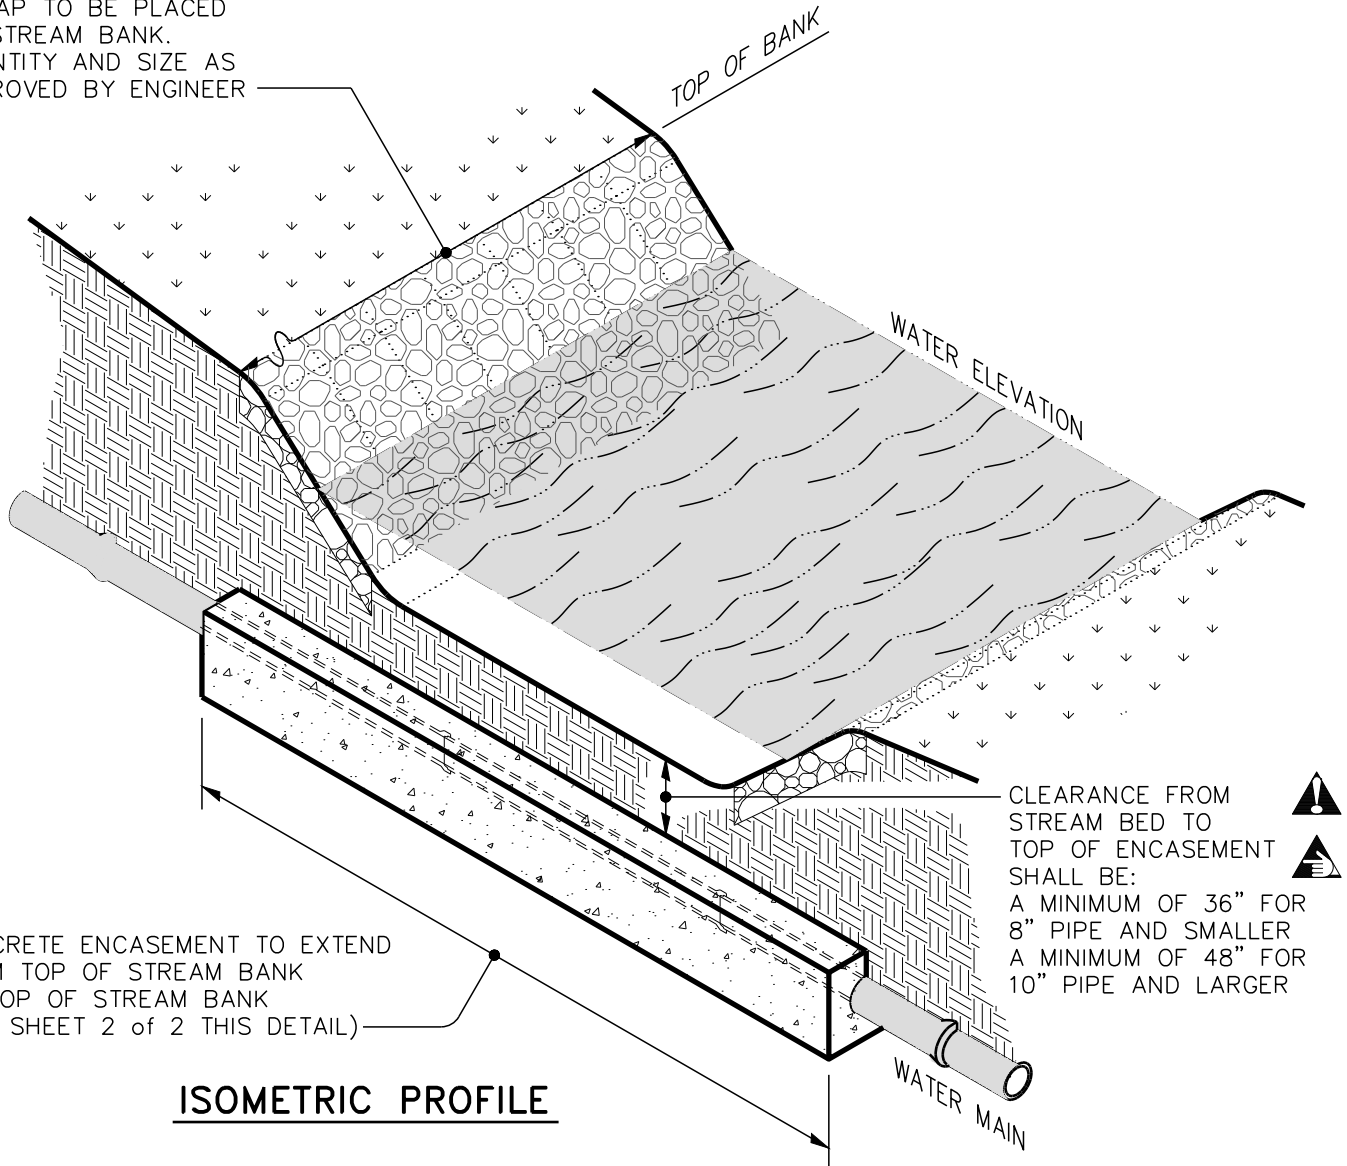

**NOTES:**

1. CONCRETE TO BE 3000 PSI.
2. ENCASEMENT TO BE USED ONLY WHERE SPECIFIED ON PLANS.
3. PIPE SHALL BE DUCTILE IRON PIPE.
4. FILTER FABRIC TO BE PLACED UNDER RIP-RAP AND KEYED INTO EMBANKMENT.



**THE CITY OF LYNCHBURG**

WATER LINE CROSSING BENEATH STREAM BED

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:  
NOT TO SCALE

DETAIL #  
**26.22**

REVISION DATE:  
4-2020

SHEET #:  
1 OF 2