


DIP AND CONCRETE PIPE

PP PIPE

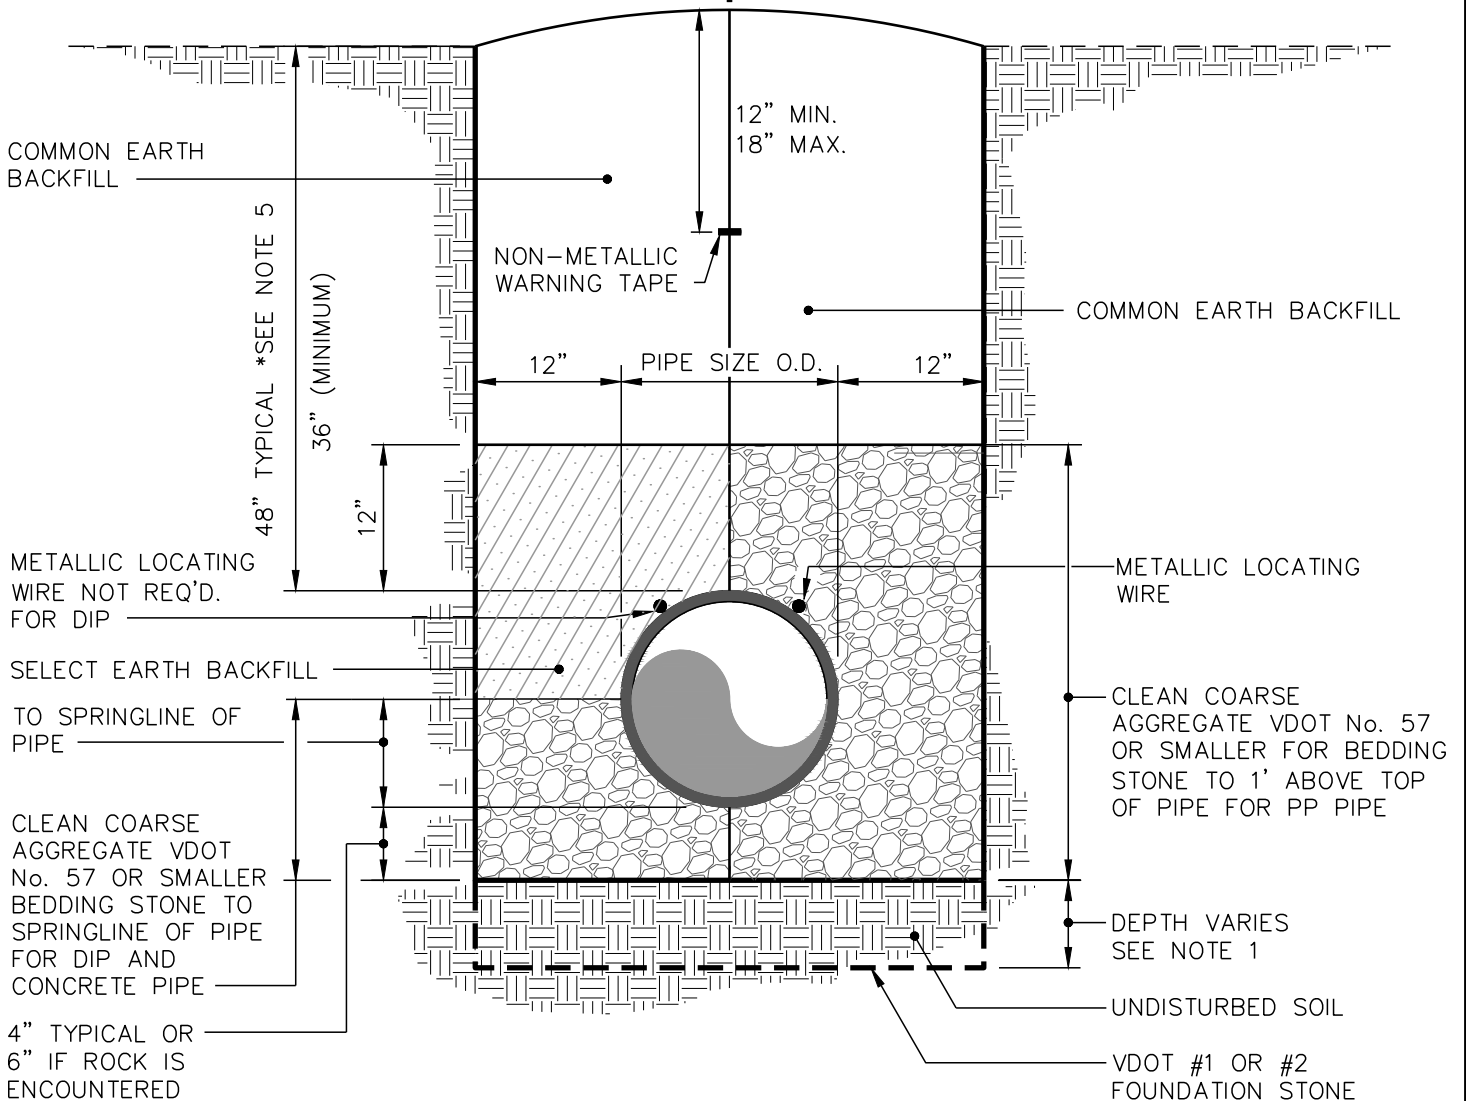

NOTES:

1. FOUNDATION STONE SHALL BE REQUIRED WHEN SOIL CONDITIONS ARE UNSUITABLE.
2. EXTRA DEPTH EXCAVATION SHALL BE PAID FOR AS ANYTHING BEYOND 4' OF COVER TO TOP OF PIPE.
3. AN ADDITIONAL 1 INCH DEPTH OF BEDDING STONE WILL BE REQUIRED FOR EACH ADDITIONAL 2 FEET OF TRENCH DEPTH IN EXCESS OF 16 FEET UP TO A MAXIMUM OF 12 INCHES.
4. NON-METALLIC WARNING TAPE AND METALLIC LOCATING WIRE NOT REQUIRED FOR CULVERTS UNDER ROAD.
5. IF COVER DEPTH IS LESS THAN 3 FEET, DIP OR RCP SHALL BE REQUIRED UNLESS OTHERWISE DIRECTED BY THE CITY ENGINEER.
6. FOR TRENCH DEPTHS 2 FEET OR LESS UNDER PAVEMENT CLEAN COARSE AGGREGATE BACKFILL WITH VDOT No. 21A OR SMALLER TO PAVEMENT PATCH



THE CITY OF LYNCHBURG

STORM SEWER LINE TRENCH DETAIL

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:
NOT TO SCALE

DETAIL #
27.01A

REVISION DATE:
4-2020

SHEET #:
1 OF 1

5/05/2020 - 11:36:43am