


PLAN VIEW

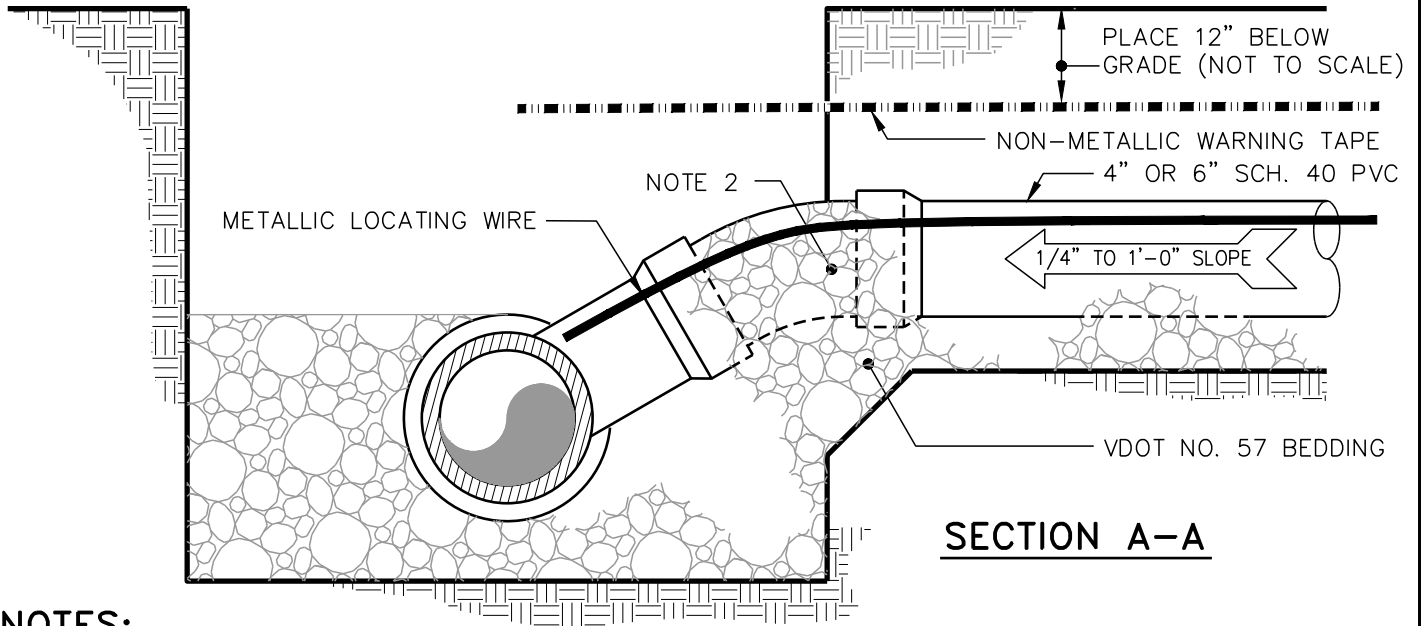

SECTION A-A

NOTES:

1. STONE SHALL BE INSTALLED TO TOP OF PIPE FOR PVC PIPE.
STONE SHALL BE INSTALLED TO D/8 FOR DI PIPE.
2. NON-METALLIC WARNING TAPE AND METALLIC LOCATING WIRE REQ'D. ALONG ENTIRE LENGTH OF LATERAL AND MAIN PER SPECIFICATION 02220, PARAGRAPH 3.9.1A.

5/05/2020 - 1:46:31pm



THE CITY OF LYNCHBURG

**BUILDING CONNECTION
HORIZONTAL WYE**

USE WITH THE CITY OF LYNCHBURG STANDARD SPECIFICATIONS ONLY

SCALE:
NOT TO SCALE

DETAIL #
27.14

REVISION DATE:
4-2020

SHEET #:
1 OF 1